



# MT6200 多功能數位顯示控制器

MT6200 Multi-Function Digital Display Controller

大視窗 2 公分 4 位數字體，可做 4 段輸出控制，多元化輸入信號，1 組 DC24V 輔助電源輸出，適用溫度、濕度、壓力、水位、流量、氣體等設備使用~

## 訂購型號 Ordering Information

MT6200 - 代碼1 - 代碼2 - 代碼3 - 代碼4 - 代碼5												
輸入信號	熱電偶	T	輸出	繼電器 OUT/AL4	R	警報	1組	1	通訊應用	不選擇	N	電源電壓
	白金熱電阻	D		線性電流 4-20mA	M	2組	2	4-20mA 再傳輸	R	AC90~250V 50/60Hz		
	類比信號	L				3組	3	RS485	C	DC24V		
								0-10V	V			
											A	
											D	

## 特點 Features

- 4 位數 0.8" LED 顯示器，可應用於流量、水位、壓力、氣體、溫濕度等功能
- 各式熱電偶、熱電阻，直流類比信號輸入選擇
- 標準一組接點 RELAY 輸出、一組警報，警報擴充至三組，可規劃時間計時功能，警報模式可參數設定 Hi 或 Lo，並可搭配主輸出做偏差上、下限，區域內、外警報，具有八種模式可選擇規劃
- 4-20mA 實際值再傳輸，可搭配記錄器、監控系統等使用
- RS485 通訊功能(MODBUS RTU 格式) N82
- 可選擇工作電源電壓 DC24V 電源輸入
- 內建 DC24V 補助電壓輸出，可搭配前端傳送器工作電壓使用

## 主要規格 Specifications


- 輸入：熱電偶種類 J. K. T. E. B. R. S. N. C  
白金熱電阻 DIN PT-100、JIS PT-100  
類比信號 4-20mA、0-50mV、1-5V、0-10V
- 精度：熱電偶  $\pm 1^{\circ}\text{C}$ 、白金熱電阻  $\pm 0.2^{\circ}\text{C}$ 、類比信號  $\pm 3\mu\text{V}$ 、 $\leq \pm 0.1\% \text{ FS}$
- 取樣時間：0.5秒
- 輸出：繼電器：5A/AC240V，電氣壽命  $10^4$  次以上(額定負載內)
- 耐壓能力：主迴路-外殼對地 1500V/1M  
控制迴路-外殼對地 1000V/1M
- 記憶體：斷電保持記憶 EEPROM
- 消耗電力：3VA 以內
- 對應範圍值：-1999~9999
- 小數點位數設定：輸入溫度 Sensor 小數點一位，類比信號小數點可設 3 位數
- 電源電壓：AC90~250V 50/60Hz，DC24V
- 操作環境：溫度 0~50°C；濕度 0~90%

盤面安裝抽取式，免拆線方便現場更換使用



## 面板操作說明


### Operating Instruction

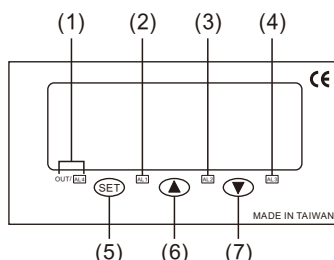

- (1) OUT/A4 控制輸出指示燈
- (2) AL1 第一組警報輸出指示燈
- (3) AL2 第二組警報輸出指示燈
- (4) AL3 第三組警報輸出指示燈
- (5) SET 參數循環確認鍵
- (6) ▲：上加鍵
- (7) ▼：下減鍵



## 外觀尺寸圖

### Package Information

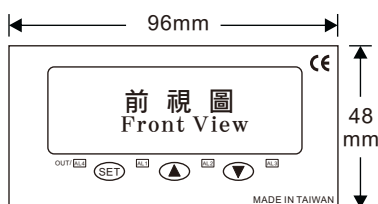


## 開孔尺寸圖

### Locate Description

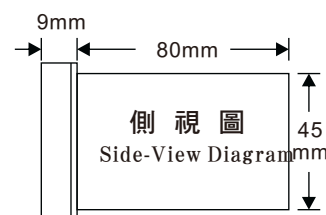

## 接線圖 Connect Diagram

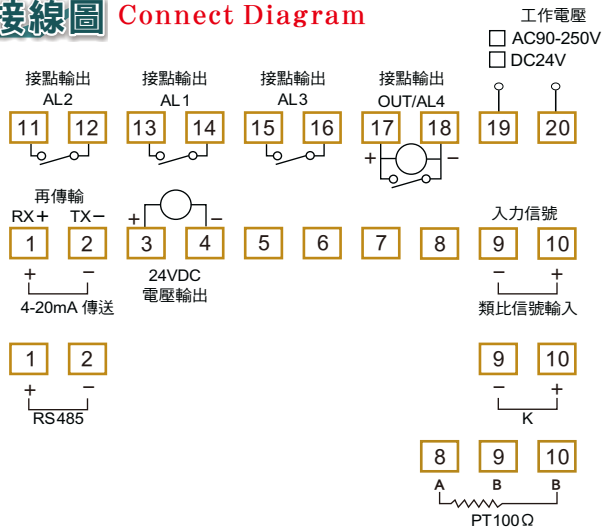

## 輸入種類PC板規劃

specification option of PCB

	GX	GY	GA
TC	ON	OFF	OFF
PT	ON	OFF	OFF
mA	ON	OFF	ON
mV	ON	OFF	OFF
V	OFF	ON	OFF

例輸入 4-20mA

GA ☐ 短路


GY ☐ ☐

GX ☐ 短路



## 腳位說明圖 Pin Description

- 1+、2- 4-20mA 再傳送(RS485 輸出選購只能選購其中一種功能)
- 3+、4- DC24V 輸出，可提供傳送器或傳感器工作電源使用
- 9-、10+ 輸入信號(類比信號及溫度 K 選購其中一種功能)
- 8A、9B、10B 輸入溫度 PT100Ω、電阻信號
- 11、12 第二段接點 RELAY(警報 2)
- 13、14 第一段接點 RELAY(警報 1)
- 15、16 第三段接點 RELAY(警報 3)
- 17、18 主輸出 RELAY 可設定數值控制，並可帶動警報配合設定，可做偏差上、下限，區域內、外警報
- 19、20 工作電源 AC90~250V(DC24V 選購)

## 接線應用圖 Connecting Application

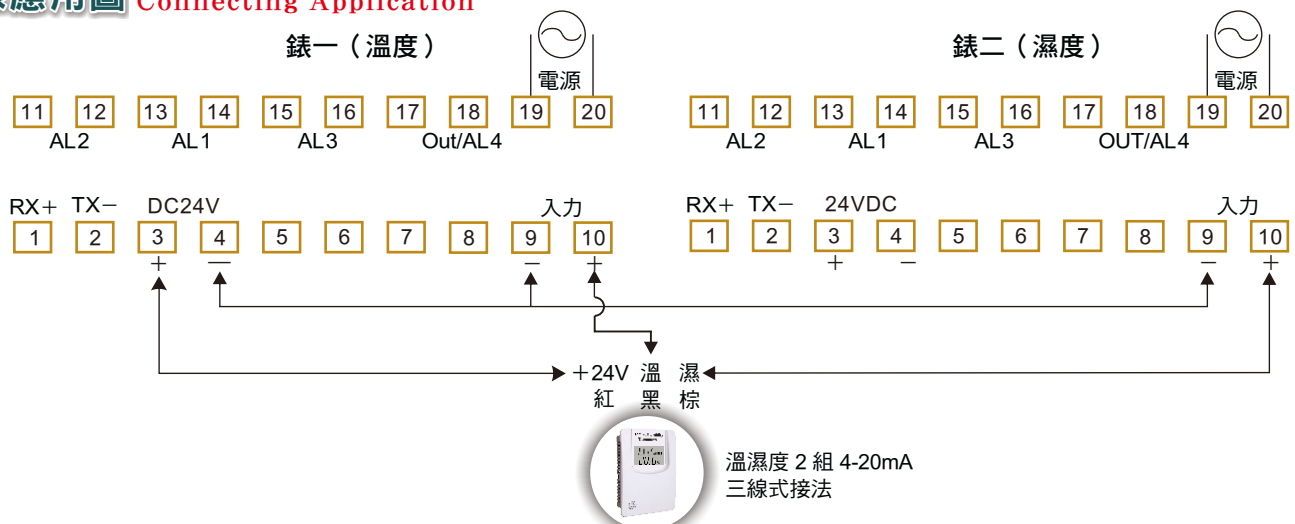


## 接線應用圖 Connecting Application

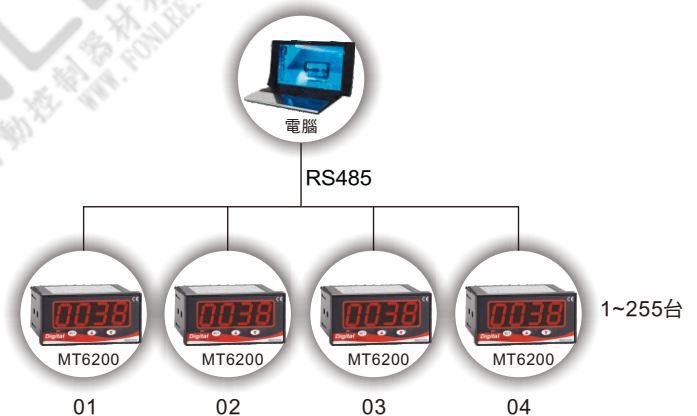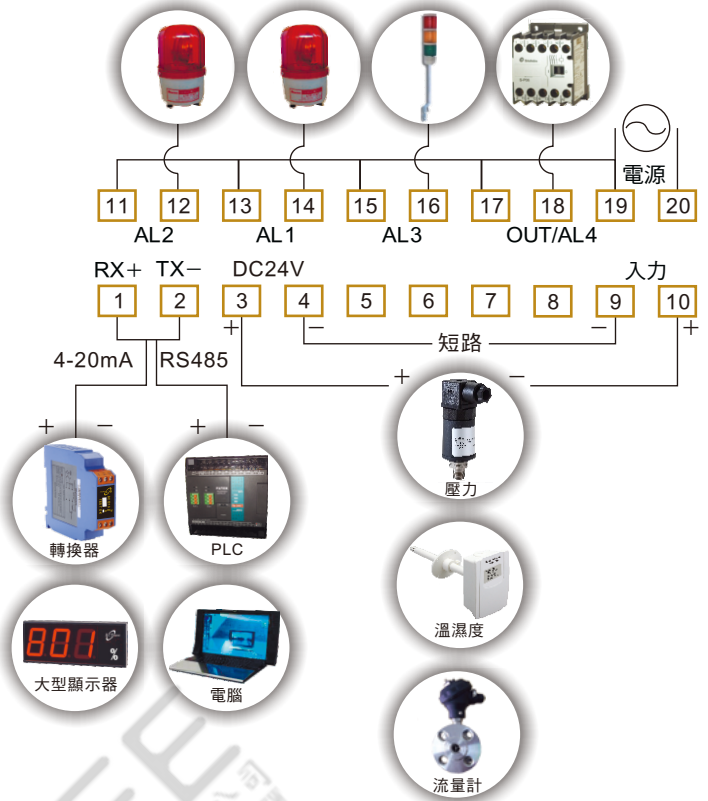

# MT6200 說明書

## 各階層參數說明

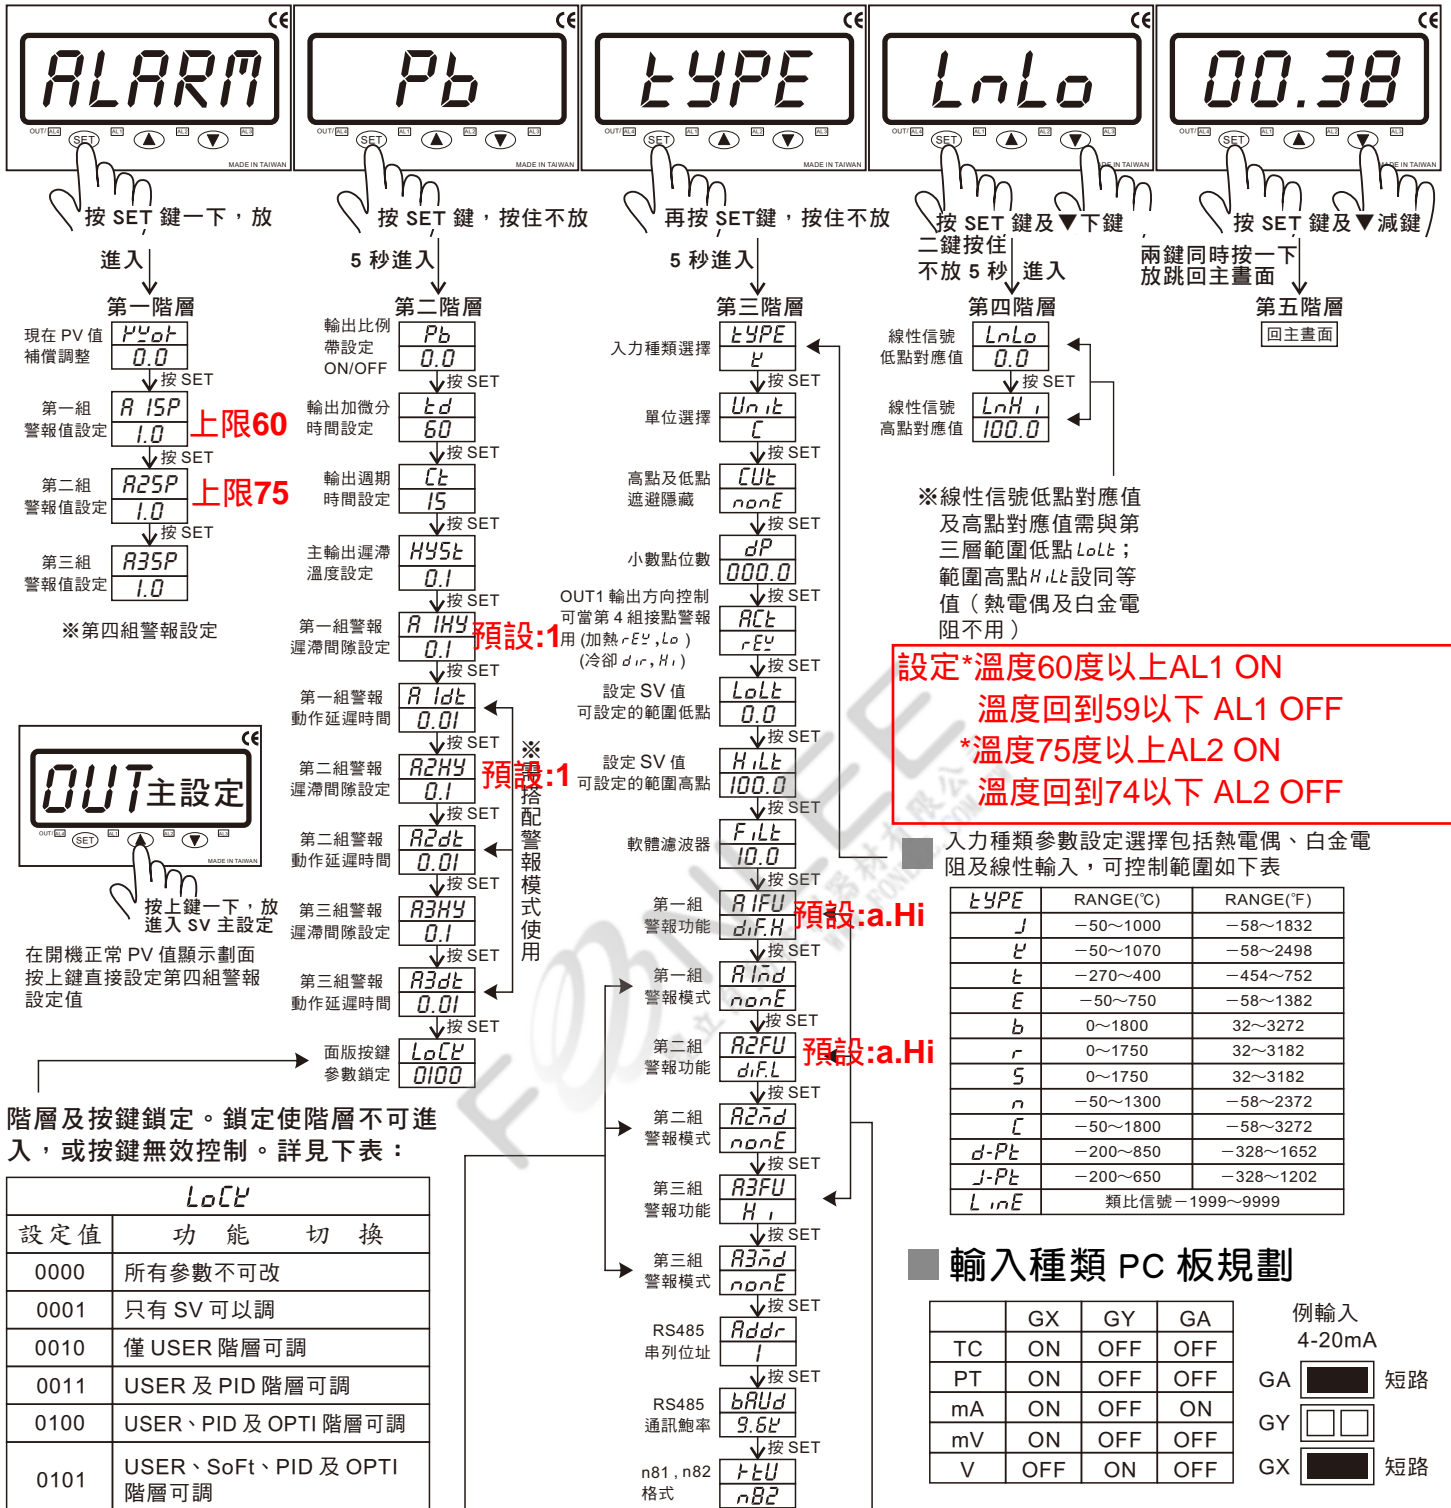

階層及按鍵鎖定。鎖定使階層不可進入，或按鍵無效控制。詳見下表：

設定值	功能	切換
0000	所有參數不可改	
0001	只有 SV 可以調	
0010	僅 USER 階層可調	
0011	USER 及 PID 階層可調	
0100	USER、PID 及 OPTI 階層可調	
0101	USER、SoFt、PID 及 OPTI 階層可調	
0110-0111	所有階層開放調整	
1XXX	當最高位數改為 1 時，多開放第二組輸出，其它功能同上	

## 警報模式


ALMD	說明
nonE	不附加特殊模式
Stdy	第一次不警報
LrLH	警報後不回復
StLR	第一次不警報，警報後不回復
HHn	時分延遲、復歸後不解除警報
nS	分秒延遲、復歸後不解除警報
RIHd	時分延遲、復歸後解除警報
n.S	分秒延遲、復歸後解除警報

## 警報功能種類設定

說明	警報動作圖示	說明	警報動作圖示
nonE A接點不警報		nonE A接點不警報	
R.HI 絕對上限A接點警報	ON → PV	R.bdH 區域外A接點警報	ON → PV
R.Lo 絕對下限A接點警報	ON → PV	R.bdLo 區域內A接點警報	ON → PV
R.dIFH 偏差上限A接點警報	ON → PV	R.ton A接點延遲警報 ON	ON → PV
R.dIFL 偏差下限A接點警報	ON → PV	R.toFF A接點延遲警報 OFF	ON → PV

※ 以上為 A 接點警報動作，B 接點警報動作與 A 接點警報動作反向  
※ 偏差上、下限，區域外、區域內警報需搭配主輸出使用


## 面版指示說明

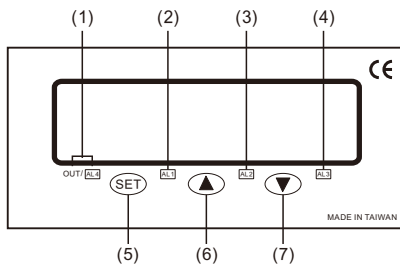


- (1) OUT/A4 控制輸出指示燈  
(2) AL1 第一組警報輸出指示燈  
(3) AL2 第二組警報輸出指示燈  
(4) AL3 第三組警報輸出指示燈  
(5) SET 參數循環確認鍵  
(6) ▲：上加鍵  
(7) ▼：下減鍵

※ 當超過一分鐘未按任何按鍵，程式將會自動回到主畫面

## 開機畫面

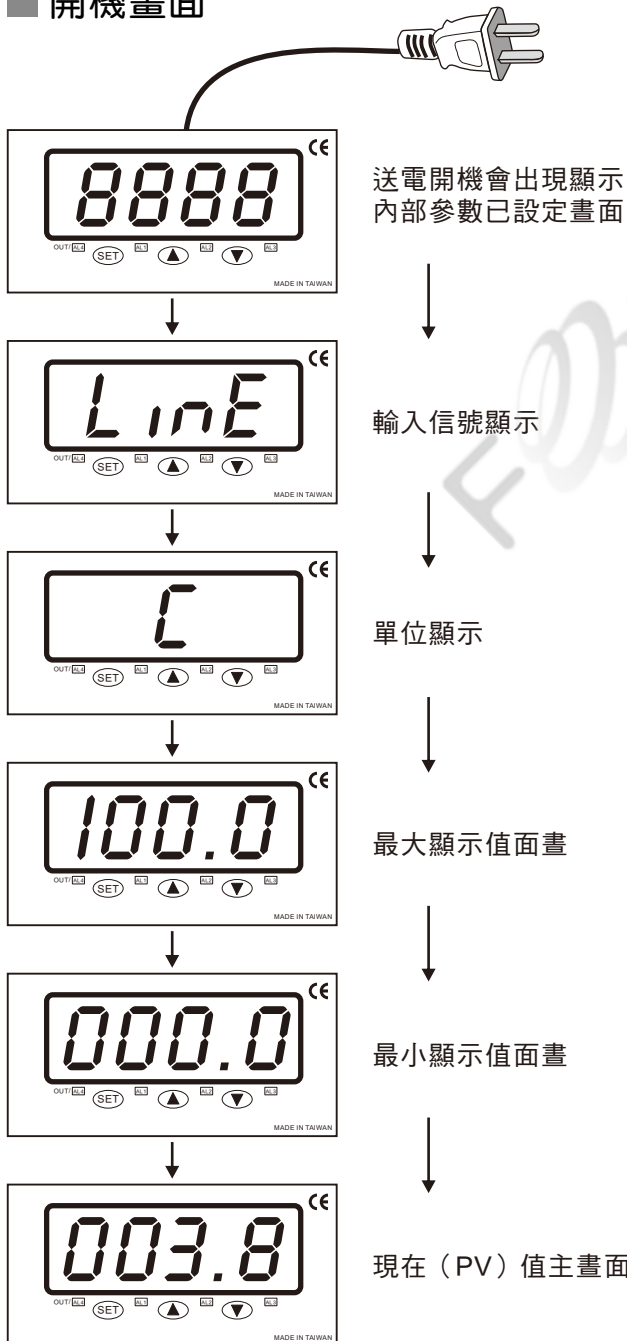

## 配線腳位說明圖

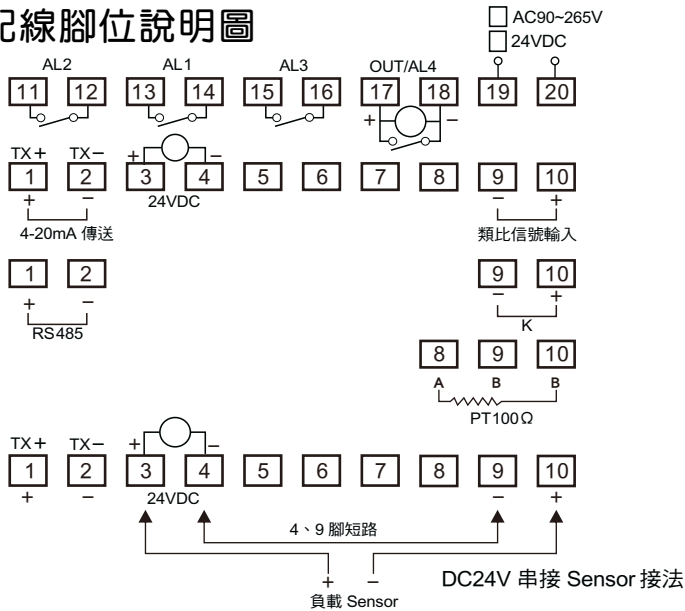


- [1+]、[2-] 4-20mA 再傳送 (RS485 輸出選購只能選購其中一種功能)
- [3+]、[4-] DC24V 輸出，可提供傳送器或傳感器工作電源使用
- [9+]、[10-] 輸入信號 (類比信號及溫度 K 選購其中一種功能)
- [8A]、[9B]、[10B] 輸入溫度 PT 100Ω、電阻信號
- [11]、[12] 第二段接點 RELAY (警報 2)
- [13]、[14] 第一段接點 RELAY (警報 1)
- [15]、[16] 第三段接點 RELAY (警報 3)
- [17]、[18] 主輸出 RELAY 可設定數值控制，並可帶動警報配合設定，可做偏差上、下限，區域內、外警報
- [19]、[20] 工作電源 AC90~264V (DC24V 選購)

## 故障訊息檢修

故障訊息	故障狀況	排除方法
PV 值閃爍	入力信號超出上下限值	1. 調整適當上下限值 2. 檢查入力信號是否過高或過低
oPEn	入力信號斷線或開路	1. 檢查入力線接點是否正確 2. 檢查入力線是否斷路 3. 檢查入力線是否損壞
階層 Level	USER / PID / OPT / 無法調整 PID Level 無法調整 OPT1 Level 無法進入或調整	檢查 LOCK 設定是否正確
控制功能	輸出控制完全錯誤或失控	檢查 Act 的設定 rEv, dir 是否錯誤
	量測溫度與實際溫度誤差過大	1. 檢查 PvoF 是否設定錯誤，或更改 PvoF=0 再測試 2. 檢查 tyPE 及 Unit 是否設定錯誤
RS-485 通訊	設定溫度與穩定溫度誤差過大	檢查 SpoF 是否設定錯誤，或 SpoF=0 再測試
	RS-485 通訊無效	請確定有訂購 RS-485 通訊功能並有安裝過通訊模組
RS-485 通訊	RS-485 通訊失效	1. 通訊軟體需符合 Mod Bus protocol 2. 確認 Addr 參數與軟體位址設定是否相符 3. 確認 bAUd 參數與軟體速率設定是否相符

## 開孔尺寸

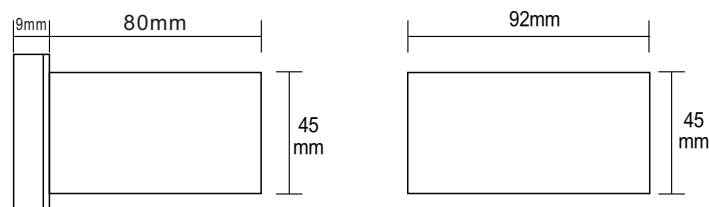



# MT6200 通訊協定

<b>1. COMMUNICATION FUNCTIONS</b>	
<b>1.1 General</b>	<b>1</b>
<b>2. SPECIFICATIONS</b>	
<b>2.1 Communication Specifications</b>	<b>1</b>
<b>3. CONNECTION</b>	
<b>3.1 Terminal Allocation</b>	<b>1</b>
<b>3.2 Wiring</b>	<b>2</b>
<b>4. SETTING OF COMMUNICATION CONDITION</b>	
<b>4.1 Set Items</b>	<b>2</b>
<b>4.2 Setting Operation Method</b>	<b>2</b>
<b>5. MODBUS COMMUNICATION PROTOCOL</b>	
<b>5.1 General</b>	<b>3</b>
<b>5.2 Composition of Message</b>	<b>3</b>
<b>5.3 Response of Slave Station</b>	<b>4</b>
<b>5.4 Function Code</b>	<b>4</b>
<b>5.5 Calculation of Error Check Code (CRC-16)</b>	<b>4</b>
<b>5.6 Transmission Control Procedure</b>	<b>5</b>
<b>6. DETAILS OF MESSAGE</b>	
<b>6.1 Read-out of Word Data [Function Code: 03]</b>	<b>6</b>
<b>6.2 Read-out of Read-Only Word Data [Function Code: 04]</b>	<b>6</b>
<b>6.3 Write-in of Word Data (1 word) [Function Code: 06]</b>	<b>7</b>
<b>7. ADDRESS MAP AND DATA FORMAT</b>	
<b>7.1 Data Format</b>	<b>7</b>
<b>7.2 Data Address Map</b>	<b>8</b>
<b>8. TROUBLESHOOTING</b>	
<b>8.1 Troubleshooting</b>	<b>8</b>

## 1. COMMUNICATION FUNCTIONS

### 1.1 General

- VD series provides a communication function by RS-485 interface, by which it can transmit and receive data to and from host computer, programmable controller, graphic display panel, etc.
- The communication system consists of master station and slave stations. Up to 255slave station can be connected per master station.
- In order that the master station and slave station can communicate, the format of the transmit/receive data must coincide. For the VD series, the format of the communication data is determined by the MODBUS protocol (RTU mode).
- Please use an RS-232C→RS-485 converter in case of designating a personal computer or other devices which have an RS-232C interface as a master station.

## 2. SPECIFICATIONS

### 2.1 Communication Specifications

Item	Specification	
Electrical specification	Based on EIA RS-485	
Transmit system	2-wire, semi-duplicate	
Synchronizing system	Asynchronous mode	
Connection format	1 : N	
Number connection unit	Up to 255 units	
Transmission distance	500m max	
Transmission speed	2400 / 4800 / 9600 / 19200 selectable	
Data format	Start bit	1 bit
	Data length bit	8 bits
	Parity bit	None
	Stop bit	2 bits
Transmission code	HEX value (MODBUS RTU mode)	
Error detection	CRC-16 bits	
Isolation	Functional isolation between transmission circuit and others (with stand voltage: 500V AC).	

A typical MODBUS protocol character is shown below:

1	2	3	4	5	6	7	8	9	10	11
Start bit	Data bits								Stop bits	

One character is including 1 Start bit and 8 Data bits and 2 Stop bits.

## 3. CONNECTION

△ **WARNING**  
For avoiding electric shock and malfunctions, don't turn on the power supply until all wiring has been completed.

### 3.1 Terminal Allocation



Terminal number	Signal name
1	+
2	-



Terminal number	Signal name
15	+
16	-



Terminal number	Signal name
13	+
14	-

### 3.2 Wiring

- Use twisted pair cables with shield.  
Recommended cable: UL2464, UL2448, etc.
- The total extension length of the cable is up to 500m. A master station and up to 255 units of the VD series can be connected per line.
- Both ends of the cable should be connecting with terminate resistors 100Ω 1/2W.
- The shield wire of the cable should be grounded at one place on the master station unit side.

## 4. SETTING OF COMMUNICATION CONDITION

In order that the master station and VD series can correctly communicate, following settings are required.

- All communication condition settings of the master station are the same as those of VD series.
- All VD series connected on a line are set to address (ADDR), which are different from each other.

### 4.1 Set Items

The parameters to be set are shown in the following table. Set them by operating the front panel keys.

Parameter	Item	Value at delivery	Setting range	Remarks
BAUD	Transmission speed	9600	2400/4800/9600/19200	Set the same communication condition to the master station and all slave station.
-----	Data length	8 bits	Fixed (can't be changed)	
-----	Stop bit	2 bit	Fixed (can't be changed)	
-----	Parity setting	None	Fixed (can't be changed)	
ADDR	Address	1	1 to 255	Set a different value to each station.

### 4.2 Setting Operation Method

The following example shows how to set the communication condition.

Example: Setting a transmission speed is 9600 bps and address at 12 on a station.

Key operation	Indication	Description
Power ON	25/100	Power on running state (PV/SV indication)
SET (5 seconds)	PB	Press SET key simultaneously for approximately 5 seconds to get level parameter.
SET (5 seconds)	TYPE	Press SET key simultaneously for approximately 5 seconds to get level parameter.
SET		Press SET key to go into level.
SET	ADDR	Press SET key repeatedly until ADDR is display.
△ or ▽	ADDR/12	Press △ or ▽ key to setting "ADDR=12"
SET	BAUD	Press SET key again to select next parameter "BAUD"
△ or ▽	BAUD/9.6K	Press △ or ▽ key to setting "BAUD=9.6K"
SET	BAUD	Press SET key to save "BAUD".
SET + ▽	25/100	Press SET + ▽ one time to return the normal indication (PV/SV indication).

## 5. MODBUS COMMUNICATION PROTOCOL

### 5.1 General

The communication system by the MODBUS protocol is that the communication is always started from the master station and a slave station responds to the received message.

Transmission procedures is as shown below.

1. The master station sends a command message to a slave station.
2. The slave station checks that the address in the received message matches with the own address or not.
3. If matched, the slave station executes the command and sends back the response message.

4. If mismatched, the slave station leaves the command message and wait for the next command message.
5. The master station can individually communicate with any one of slave stations connected on the same line upon setting the address in the command message.

## 5.2 Composition of Message

Command message and response message consist of 4 fields; Address, Function code, Data and CRC check code. And these are sends in this order. The allowable character transmitted for all fields are hexadecimal 0-9,A-F

### RTU mode framing

START	ADDRESS	FUNCTION	DATA	CRC CHECK	END
T1-T2-T3-T4	8 BITS	8 BITS	$N \times 8$ BITS	16 BITS	T1-T2-T3-T4

In the following, each field is explained.

#### 1. Start

In RTU mode, messages start with a silent interval of at least 3.5 character times. This is most easily implemented as a multiple of character times at the baud rate that is being used on the network (shown as T1-T2-T3-T4 in the figure above). The first field then transmitted is the device address.

#### 2. Address

Address is the number specifying a slave station. Valid slave device addresses are in the range of 1-255 decimal. A master addresses a slave by placing the slave address in the address field of the message. When the slave sends its response, it places its own address in this address field of the response to let the master know which slave is responding.

Address 0 is used for the broadcast address, which all slave stations recognize. When the broadcast address (address 0) is applied on the command message, no any response message will be sent from the slave stations.

#### 3. Function

This is a code to designate the function executed at a slave station. When a message is sent from a master to a slave device the function code field tells the slave what kind of action to perform. When the slave responds to the master, it uses the function code field to indicate either a normal response or that some kind of error occurred. For normal response, the slave simply echoes the original function code. For an exception response, the slave returns a code that is equivalent to the original function code with its most-signification bit set to a logic 1.

#### 4. Data

Data are the data required for executing function codes. The composition of data varies with function codes. Refer to chapter 6 for details.

A data address is assigned to each data in the temperature controller. For reading/writing the data by communication, designate the data address.

#### 5. CRC check

This is the code to detect message errors (change in bit) in the signal transmission.

On the MODBUS protocol (RTU mode), CRC-16 (Cyclical Redundancy Check) is applied. For CRC calculation method, refer to section 5.5.

#### 6. End

Following the last transmitted character, a similar interval of at least 3.5 character times marks the end of message. A new message can begin after this interval.

## 5.3 Response of Slave Station

### 1. Response for normal command

To a relevant message, the slave station creates and sends back a response message, which corresponds to the command message. The composition of



message in this case is the same as in section 5.2. Content of the data field depend on the function code. For details, refer to Chapter 6.

## 2. Response for abnormal command

If contents of a command message have an abnormality (for example, non-actual function code is designated) other than transmission error, the slave station does not execute that command but creates and sends back a response message at error detection.

The composition of response message at error detection is shown on below, the value used for function field is function code of command message plus 80H.

ADDRESS	FUNCTION (Function code + 80H)	ERROR CODE	CRC CHECK
8 BITS	8 BITS	8 BITS	16 BITS

Error Code	Contents	Description
01	Illegal function	The function code received is not an allowable action for the slave.
02	Illegal data address	The data address received is not an allowable address for the slave.
03	Illegal data value	A value contained in the data field is not an allowable value for the slave.

## 5.4 Function Code

The listing below shows the function codes supported by VD series controllers.

Function code		
Code	Function	Object
03	Read-out	Holding Register
04	Read-out	Input Register
06	Write-in	Holding Register

## 5.5 Calculation of Error Check Code (CRC-16)

CRC-16 is the 2-bytes (16-bits) error check code. From the top of the message (address) to the end of the data field are calculated.

The slave station calculates the CRC of the received message, and does not respond if the calculated CRC is different from the contents of the received CRC code.

A procedure for generating a CRC is:

1. Load a 16-bits register with FFFF hex (all 1's). Call this the CRC register.
2. Exclusive OR the first 8-bit byte of the message with the low-order byte of the 16-bit CRC registers, putting the result in the CRC register.
3. If the LSB is 0: Shift the CRC register one bit to the right (toward the LSB), Zero-filling the MSB.  
If the LSB is 1: Shift the CRC register one bit to the right (toward the LSB), Zero-filling the MSB. Exclusive OR the CRC registers with the polynomial value A001 hex.
4. Repeat step 3 until 8 shifts have been performed. When this is done, a complete 8-bit byte will have been processed.
5. Repeat step 2 through 5 for the next 8-bit byte of the message. Continue doing this until all bytes have been processed.
6. The final content of the CRC register is the CRC value. The CRC field is appended to the message as the last field in the message. When this is done, the low-order byte of the field is appended first, followed by the high-order byte. The CRC high-order byte is the last byte to be sent in the message.

## 5.6 Transmission Control Procedure

### 1. Transmission procedure of master station

The master station must proceed to a communication upon conforming to the following items.

- 1-1. Before sending a command message, provide 44 bits time or more vacant status.
- 1-2. For sending, the interval between bytes of a command message is below 22 bits time.
- 1-3. Within 22 bits time after sending a command message, the receiving status is posted.
- 1-4. Provide 44 bits time or more vacant status between the end of response message reception and beginning for next command message sending (same as in 1-1).
- 1-5. For ensuring the safety, make a confirmation of the response message and make an arrangement so as to provide 3 or more retries in case of no response, error occurrence, etc.

Note: The above definition is for most unfavorable value. For ensuring the safety, it's recommended the program of the master to work with safety factors of 2 to 3. Concretely, it is advised to arrange the program for 9600 bps with 10ms or more for vacant status (1-1), and within 1ms for byte interval (1-2) and changeover from sending to receiving (1-3).

## 2. Description

### (1). Detection of the message frame

Since the communication system uses the 2-wire RS-485 interface, there may be 2 statuses on a line below.

(a) Vacant status (no data on line)

(b) Communication status (data is existing)

Instruments connected on the line are initially at a receiving status and monitoring the line. When 22 bits time or more vacant status has appeared on the line, the end of preceding frame is assumed and, within following 22 bits time, a receiving status is posted. When data appears on the line, instruments receive it while 22 bits time or more vacant status is detected again, and the end of that frame is assumed. Data, which appeared on the line from the first 44ms time or more vacant status to the next 44 bits time or more vacant status is fetched as one frame.

- 1-1. 44 bits time or more vacant status precedes the command message sending.
- 1-2. Interval between bytes of 1 command message is smaller than 22 bits time.

### (2). Response of this instrument (VD series)

After a frame detection (22 bits time or more vacant status), this instrument carries out-processing with that frame as a command message. If the command message is destined to the own station, a response message is returned. Its processing time is 1 to 10ms (depends on contents of command message). After sending a command message, therefore, the master station must observe the following.

- 1-3. Receiving status is posted within 22 bits time after sending a command message.

## 6. DETAILS OF MESSAGE

### 6.1 Read-out of Word Data [Function Code: 03]

Read the contents of holding registers (0000~ 007D) in the slave.

Broadcast is not possible.

#### 1. Message composition

Command message composition

Address	Function	Starting Address	Word Number*	CRC-16	
01~FF	03	0xxx	0001~007E	Low-order byte	High-order byte
1 byte	1 byte	2 byte	2 bytes	2 bytes	

\* Maximum word number = 7E

Response message composition

Address	Function	Byte Number *	Word Data	CRC-16	
01 ~ FF	03	02~FC		Low-order byte	High-order byte
1 byte	1 byte	1 bytes	N bytes	2 bytes	

\* Byte number = Word number × 2

## 2. Message transmission (example)

The following show an example of reading the Setpoint Value (1000) from address No.1 controller.

Command message composition

Address	Function	Starting Address	Word Number	CRC-16	
01	03	0000	0001	840A	

Response message composition

Address	Function	Byte Number	Word Data	CRC-16	
01	03	02	03E8	B8FA	

## 6.2 Read-out of Read-Only Word Data [Function Code: 04]

Read the contents of input registers (1000~1002) in the slave.

Broadcast is not possible.

### 1. Message composition

Command message composition

Address	Function	Starting Address	Word Number	CRC-16	
01~FF	04	1xxx	0001~007E	Low-order byte	High-order byte
1 byte	1 byte	2 bytes	2 bytes	2 bytes	

Response message composition

Address	Function	Byte Number	Word Data	CRC-16	
01 ~ FF	04	02~FC		Low-order byte	High-order byte
1 byte	1 byte	1 byte	N bytes	2 bytes	

### 2. Message transmission (example)

The following show an example of reading the Process Value (27) from address No.1 controller.

Command message composition

Address	Function	Starting Address	Word Number	CRC-16	
01	04	1000	0001	350A	

Response message composition

Address	Function	Byte Number	Word Data	CRC-16	
01	04	02	001B	F93B	

## 6.3 Write-in of Word Data (1 word) [Function Code: 06]

### 1. Message composition

Command message composition

Address	Function	Starting Address	Word Data	CRC-16	
1 ~ FF	06	0xxx	0xxx	Low-order byte	High-order byte
1 byte	1 byte	2 bytes	2 bytes	2 bytes	

Response message composition

Address	Function	Starting Address	Word Data	CRC-16	
1 ~ FF	06	0xxx	0xxx	Low-order byte	High-order byte
1 byte	1 byte	2 bytes	2 bytes	2 bytes	

## 2. Message transmission (example)

The following show an example of writing the Setpoint Value to address No.1 controller.

Command message composition

Address	Function	Starting Address	Word Data	CRC-16	
01	06	0000	01F4	89DD	

Response message composition

Address	Function	Starting Address	Word Data	CRC-16	
01	06	0000	01F4	89DD	

## 7. ADDRESS MAP AND DATA FORMAT

### 7.1 Data Format

#### 1. Transmission data format

The MODBUS protocol used in this instrument (VD series) is RTU (Remote Terminal Unit) mode.

Transmitted data is “numeric value” and not “ASCII code”.

#### 2. Internal calculation value and engineering unit

There are 3 different kinds of set value in the VD series controllers.

##### 1. Normal value:

The data value is transfer into Hexadecimal regardless of decimal. For example:

1000 °C will be transfered to 03E8(hex), However, such as output percentage and Pb (proportional band), 100.0 % will be transfered to 03E8(hex).

##### 2. Index code:

Some parameters value are set by index code. For example, to change the unit to °C via communication. The data value would be 0017(hex).

Code	English	Code	English	Code	English	Code	English
00	J	0F	ENG	1E	9.6K	2D	1101
01	K	10	0000	1F	19.2K	2E	1110
02	T	11	000.0	20	0000	2F	1111
03	E	12	00.00	21	0001	30	HI
04	B	13	0.000	22	0010	31	LO
05	R	14	REV	23	0011	32	DIF.H
06	S	15	DIR	24	0100	33	DIF.L
07	N	16	NONE	25	0101	34	BD.HI
08	C	17	STDY	26	0110	35	BD.LO
09	D-PT	18	LATH	27	0111	36	T.ON
0A	J-PT	19	ST.LA	28	1000	37	T.OFF
0B	LINE	1A	HH.MM	29	1001	38	NONE
0C	°C	1B	MM.SS	2A	1010	39	LO
0D	°F	1C	2.4K	2B	1011	3A	HI
0E	ENG	1D	4.8K	2C	1100	3B	HI.LO

### 7.2 Data Address Map

■ Word data (read-out/write-in) : Function code [03,,05,06]

Data Address	Parameter	Range	Unit
0000	SV	HiLt~LoLt	°C/°F
0001	SPOF	-1000~1000	°C/°F
0002	PVOF	-1000~1000	°C/°F
0003	A1SP	-1000~1000	°C/°F

0004	A2SP	-1000~1000	°C/°F
0005	A3SP	-1000~1000	°C/°F
0006	PB	0.0~300.0	%
0007	TD	900	Sec
0008	CT	0~100	Sec
0009	HYST	0~2000	°C/°F
000A	A1HY	0~2000	°C/°F
000B	A2HY	0~2000	°C/°F
000C	A3HY	0~2000	°C/°F
000D	LOCK	0000~1111	
000E	TYPE	J/K/B/R/S/T/E/N/C/DPT/JPT/LINE (English code)	
000F	UNIT	°C / °F / ENG (English code)	
0010	DP	0000/000.0/00.00/0.000 (English code)	
0011	ACT	REV / DIR(English code)	
0012	LOLT	-1999~9999	°C/°F
0013	HILT	-1999~9999	°C/°F
0014	FILT	0.0~-100.0	
0015	A1FU		
0016	A1MD		
0017	A2FU		
0018	A2MD		
0019	A3FU		
001A	A3MD		
001B	ADDR	0~255	0
001C	BAND		
001D	CH01	0~2000	
001E	CL01	0~2000	
001F	RTSH	0~3000	
0020	RTSL	0~3000	
0021	MR	0.0~100.0	%

■ Word data (read-out only) : Function code [04]

Data Address	Parameter	Contents	Unit
1000	PV	Process value	
1003	LED	BIT,S8,S7,S6,S5,S4,S3,S2,S1,PTN2,PTN1,RUN,PRO,C2,C1,A2,A1	
1004	MCODE	14=VT26,1E=VT30,07D0=VD	

## 8. TROUBLESHOOTING

### 8.1 Troubleshooting

**If the communication is unavailable, check the following items.**

- ☐ Whether all devices related to communication are turned on.
- ☐ Whether connections are correct.
- ☐ Whether the number of connected instruments and connection distance are as specified.
- ☐ Whether communication conditions coincide between the master station (host computer) and slave station (VD).
  - ☐ Transmission speed : ☐ 2400 bps ☐ 4800 bps ☐ 9600 bps ☐ 19200 bps
  - ☐ Address :01 ~ FF (master and slave station must be match)
- ☐ Whether send/receive signal timing conforms to Section 5.4 in the manual.
- ☐ Whether more than one instrument connected on the same transmission line share the same address.